
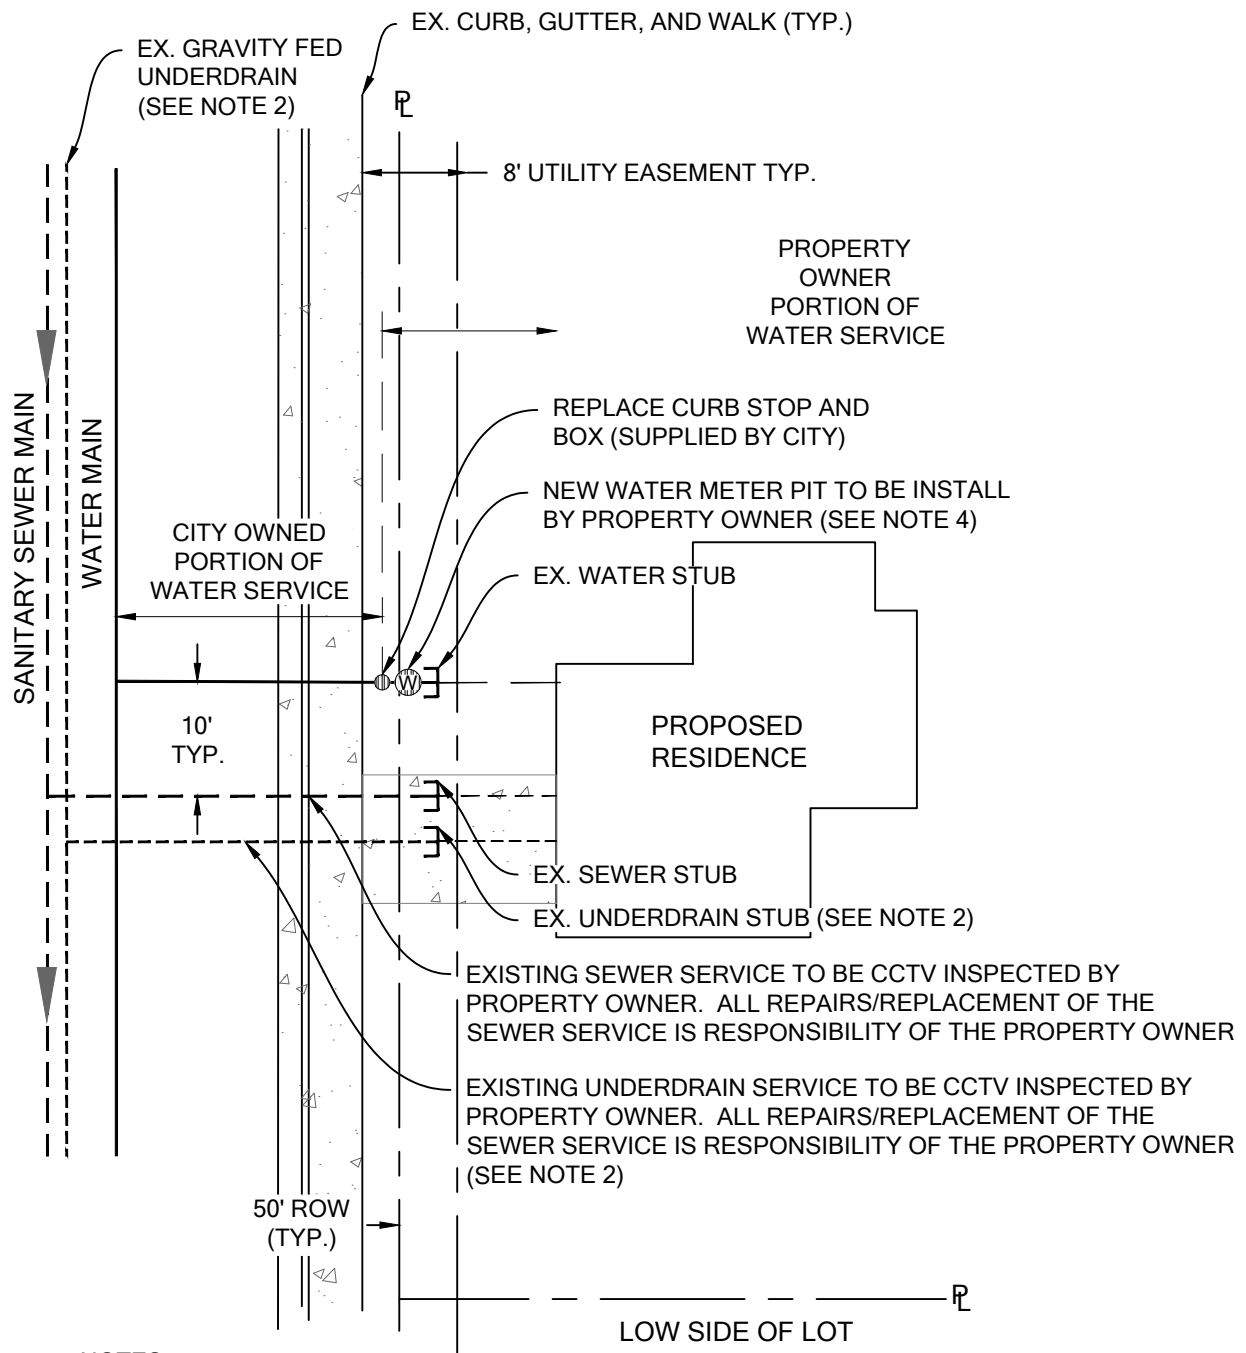


NOTES:


1. SERVICES TO BE LOCATED BY THE CONTRACTOR.
2. GRAVITY FED UNDERDRAIN ONLY IN CERTAIN SUBDIVISIONS SEE CONSTRUCTION PLAN AS-BUILTS.


REVISIONS		 City of Louisville COLORADO - SINCE 1882	DEPARTMENT OF PUBLIC WORKS	DRAWN BY: AF 04-11-22 APPROVED BY: CF 04-11-22
DATE	BY			SHEET 1 OF 3
MARSHALL FIRE TYPICAL LOT DEMOLITION				



NOTES:

1. SERVICES TO BE LOCATED BY THE CONTRACTOR.
2. GRAVITY FED UNDERDRAIN ONLY IN CERTAIN SUBDIVISIONS SEE CONSTRUCTION PLAN AS-BUILTS.
3. SEE DETAIL 36 FOR CURB STOP.
4. SEE DETAIL 18 FOR WATER METER. NEW METER PIT, FRAME, LID, SETTER (SUPPLIED BY CITY). METER TO BE INSTALLED BY CITY.
5. SEE DETAIL 9 FOR SANITARY SEWER SERVICE REPLACEMENT.

REVISIONS		 City of Louisville DEPARTMENT OF PUBLIC WORKS COLORADO - SINCE 1882	DRAWN BY: AF 04-11-22 APPROVED BY: CF 04-11-22
DATE	BY		
		MARSHALL FIRE TYPICAL LOT REHABILITATION	SHEET 2 OF 3

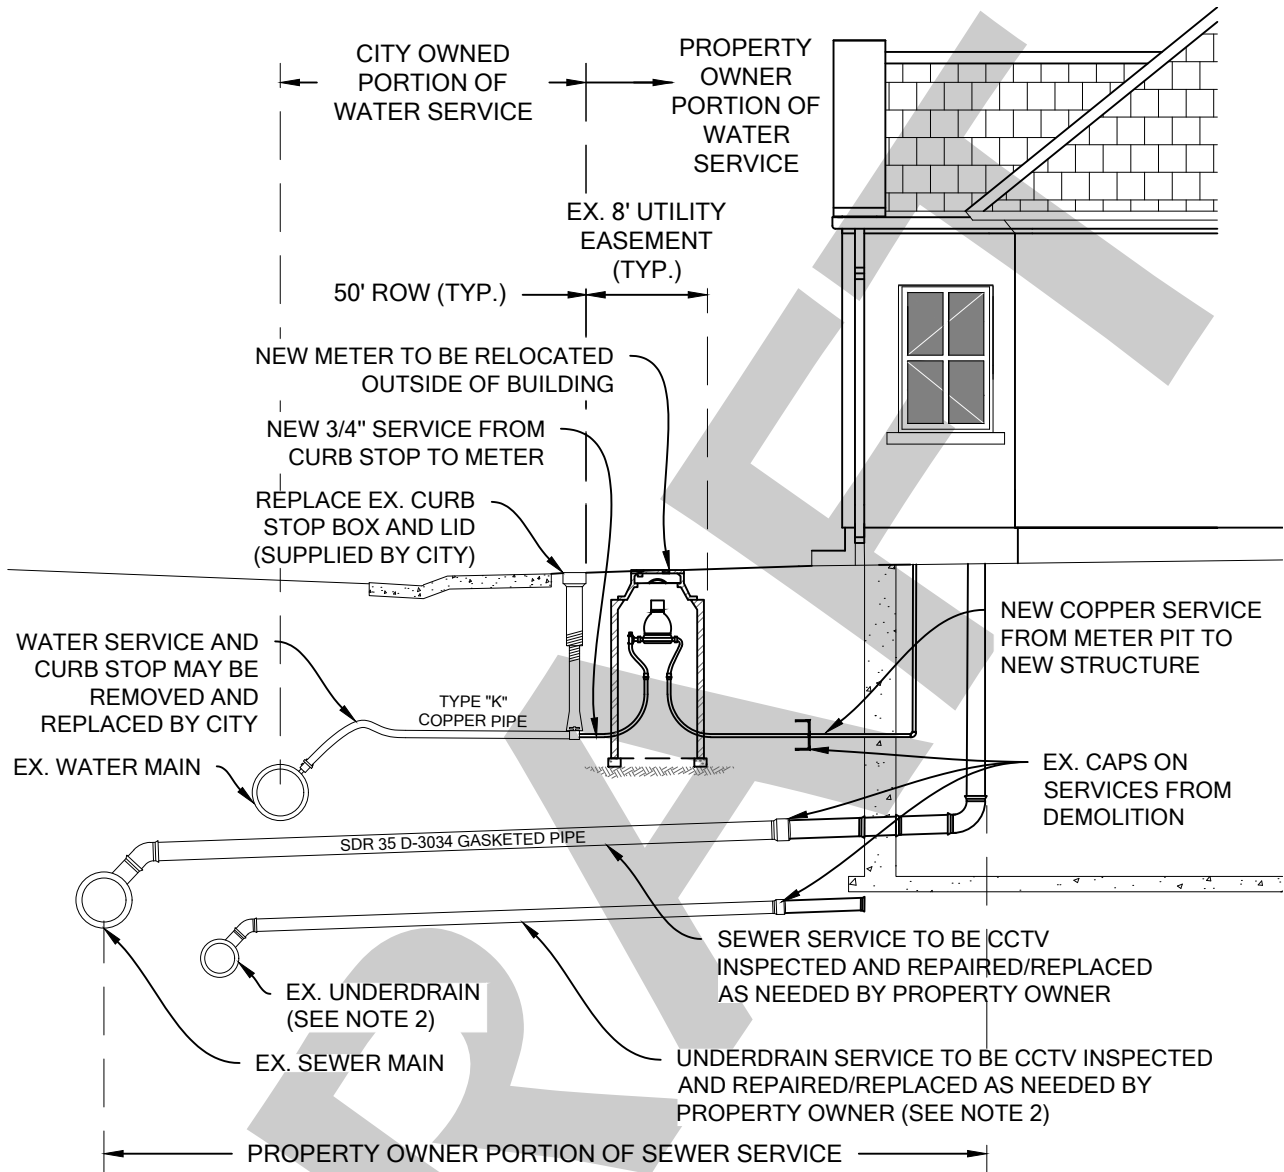


NOTES: WATER

1. CURB STOP SHALL BE CORRECTED PRIOR TO WATER METER INSTALLATION.
2. GRAVITY FED UNDERDRAIN ONLY IN CERTAIN SUBDIVISIONS SEE CONSTRUCTION PLAN AS-BUILTS.
3. CITY WILL SUPPLY AND INSTALL METER AFTER ALL PLUMBING IS INSTALLED, TESTED AND FLUSHED.
4. CITY TO SUPPLY PIT, COMPOSITE RING AND COVER, METER, AND METER SETTER. CITY WILL SET THE METER ONCE ALL ITEMS ARE INSTALLED BY CONTRACTOR.
5. CONTRACTOR TO SUPPLY AND INSTALL STRUCTURAL SUPPORT FOR METER AND SETTER AS DIRECTED BY CITY.

NOTES: SEWER

1. THE MIN. SERVICE LINE SLOPE SHALL BE 1/4" PER FOOT.
2. ALL JOINTS SHALL BE GASKETED WATER TIGHT.
3. ALL SERVICE LINES SHALL BE 4" UNLESS OTHERWISE APPROVED.

REVISIONS		 City of Louisville DEPARTMENT OF PUBLIC WORKS COLORADO - SINCE 1882	DRAWN BY: AF 04-11-22 APPROVED BY: CF 04-11-22
DATE	BY		
		MARSHALL FIRE SERVICE INSTALLATION	SHEET 3 OF 3